

Job Name:	
System Reference:	Date:



OUTDOOR VRF HEAT PUMP WITH HEAT RECOVERY SYSTEM

UNIT OPTION

- Standard Model.....PURY-P120TLMU-A
- Seacoast (BS) Model.....PURY-P120TLMU-A-BS

ACCESSORIES

- Joint Kit.....for details see Pipe Accessories Submittal
- BC Controller (required).....for details see BC Controller Submittals
- Low Ambient Kitfor details see Low Ambient Kit Submittal
- Snow/Hail Guards Kit.....for details see Snow/Hail Guards Kit Submittal
- Base Pan Heater Kit.....for details see Base Pan Heater Kit Submittal

Specifications		Model Name
Unit Type		PURY-P120TLMU-A (-BS)
Nominal Cooling Capacity (208/230V)	Btu/h	120,000
Nominal Heating Capacity (208/230V)	Btu/h	135,000
Operating Temperature Range *1	Cooling (Outdoor) *2	23~126° F (-5~52° C) DB
	Heating (Outdoor)	-13~60° F (-25~15.5° C) WB
External Dimensions (H x W x D)	In. (mm)	64-31/32 x 68-29/32 x 29-5/32 (1,650 x 1,750 x 740)
Net Weight	Lbs. (kg)	695 (315)
External Finish		Pre-coated galvanized steel sheet
Electrical Power Requirements	Voltage, Phase, Hertz	208 / 230V, 3-Phase, 60Hz
Minimum Circuit Ampacity (MCA)	A	42 / 39
Maximum Overcurrent Protection (MOP)	A	60 / 60
Piping Diameter (Brazed) (In. / mm)	Liquid (High Pressure)	3/4 (19.05)
	Gas (Low Pressure)	1-1/8 (28.58)
Max. Total Refrigerant Line Length	Ft.	1,969
Max. Refrigerant Line Length (Between ODU & IDU)	Ft.	541
Max. Control Wiring Length	Ft.	1,640
Indoor Unit	Total Capacity	50~150% of outdoor unit capacity
	Model / Quantity	P06~P96/1~30
Sound Pressure Levels	dB(A)	60.0
Fan		
Type x Quantity		Propeller fan x 2
Airflow Rate	CFM	11,300
External Static Pressure	In. WG	Selectable; 0, 0.12 or 0.24"WG; factory set to 0"W.G.
Compressor Operating Range		15% to 100%
Compressor Type x Quantity		Inverter scroll hermetic compressor
Refrigerant		R410A; 23 lbs. + 2 oz. (10.5 kg)
Protection Devices	High Pressure	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter Circuit (Comp. / Fan)	Over-current protection
	Fan Motor	Thermal switch
AHRI Ratings (Ducted/Non-Ducted)	EER	12.8 / 14.7
	IEER	19.9 / 24.6
	COP	3.52 / 3.99
	SCHE	25.3 / 30.3

NOTES:
 *1. When applying product below -4° F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating.
 *2. For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal.

Model: PURY-P120TLMU-A (-BS) – DIMENSIONS

- <Accessories>
 • Connecting pipe
 • Low pressure>
 • Elbow (ID ϕ 25.58(1-1/8) \times OD ϕ 28.58(1-1/8)) ... P120.P144.P168 1pc.
 • High pressure>
 • Pipe (ID ϕ 25.4(1) \times OD ϕ 19.05(3/4)) ... P120 1pc.
 • Pipe (ID ϕ 25.4(1) \times OD ϕ 19.05(3/4)) ... P120 1pc.
 • Pipe (ID ϕ 25.4(1) \times OD ϕ 22.2(7/8)) ... P144.P168 1pc.
 • Pipe (ID ϕ 25.4(1) \times OD ϕ 22.2(7/8)) ... P144.P168 1pc.

Note1. Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater.
 2. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).


Connecting pipe specifications

Model	Refrigerant pipe		Diameter		Service valve
	High pressure	Low pressure	High pressure	Low pressure	
PURY-P120TLMU	ϕ 19.05 Braze (3/4)*1	ϕ 28.58 Braze (1-1/8)*1	ϕ 25.4 (1)	ϕ 28.58 (1-1/8)	ϕ 28.58 (1-1/8)
PURY-P144TLMU	ϕ 22.2 Braze (7/8)*1	ϕ 28.58 Braze (1-1/8)*1	ϕ 25.4 (1)	ϕ 28.58 (1-1/8)	ϕ 28.58 (1-1/8)
PURY-P168TLMU	ϕ 22.2 Braze (7/8)*1	ϕ 28.58 Braze (1-1/8)*1	ϕ 25.4 (1)	ϕ 28.58 (1-1/8)	ϕ 28.58 (1-1/8)

*1 Use the included connecting pipe and connect to the refrigerant service valve piping.

NO.	Usage	Specifications
①	Front through hole	140 x 77 Knockout hole (5-9/16)(3-1/16)
②	For pipes (Uses when twinning kit (optional parts) is mounted.)	ϕ 45 Knockout hole (1-13/16)
③	Bottom through hole	150 x 94 Knockout hole (5-15/16)(3-3/4)
④	Front through hole	ϕ 62.7 or ϕ 64.5 Knockout hole (2-1/2)(1-3/8)
⑤	Front through hole	ϕ 43.7 or ϕ 22.2 Knockout hole (1-3/4)(7/8)
⑥	Bottom through hole	ϕ 65 Knockout hole (2-9/16)
⑦	Bottom through hole	ϕ 52 Knockout hole (2-1/16)
⑧	For transmission cables	ϕ 34 Knockout hole (1-3/8)

Unit: mm (in.)

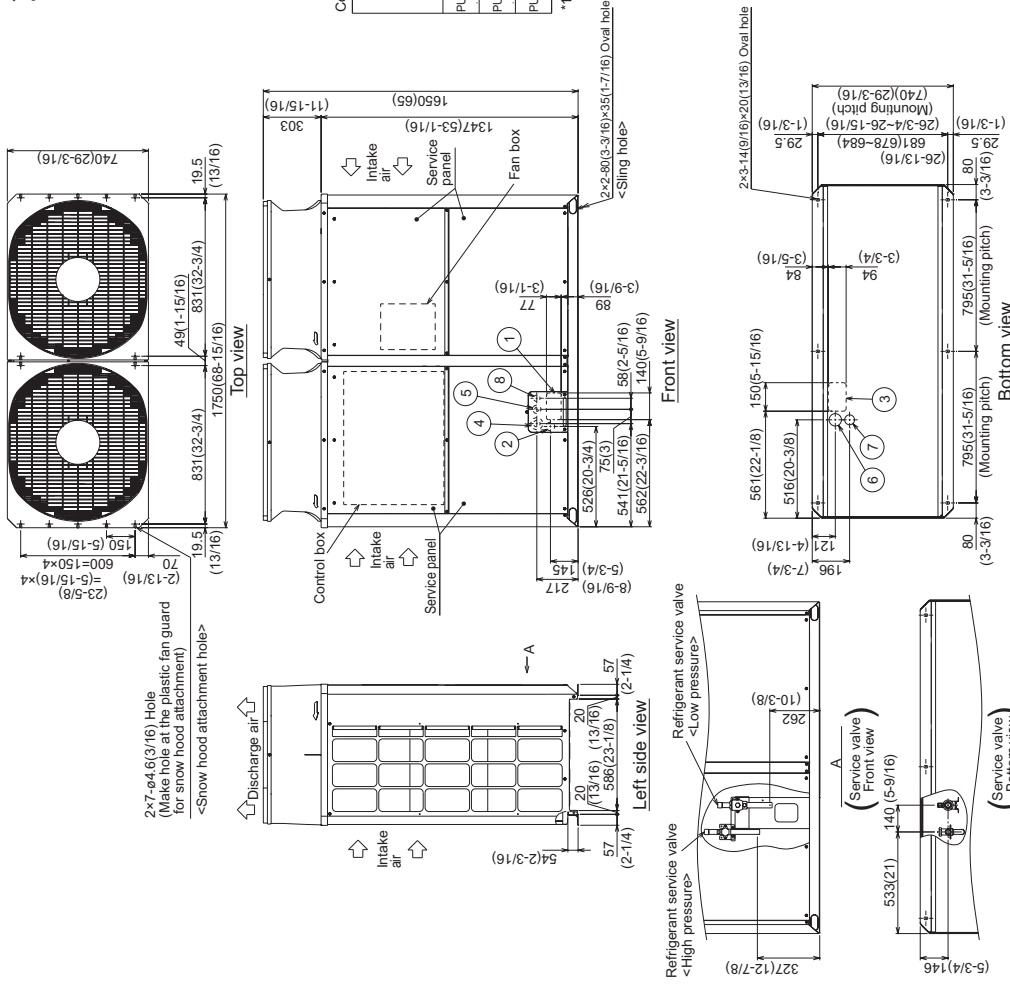

NOTES:

SEACOAST PROTECTION

- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.



COOLING & HEATING

1340 Satellite Boulevard, Suwanee, GA 30024
 Toll Free: 800-433-4822 www.mehvac.com

